

INSTALLATION FOR CNM-456075-WCP-DB CANOPY



SAVE THESE INSTRUCTIONS - READ ALL INSTRUCTIONS CAREFULLY

⚠ WARNING

PLEASE READ ALL INSTRUCTIONS BEFORE ATTEMPTING INSTALLATION.

- To avoid risk of fire or electrical shock, this product should be installed and maintained by a qualified electrician in accordance with all national and regional electrical codes.
- Turn off power to fixture during installation and maintenance.
- Any alteration or modification of this product is forbidden as it may cause personal injury, death, property damage and / or product malfunction.
- To prevent product malfunction and / or electrical shock this product must be properly grounded.
- Canopy fixture must be operated within an ambient temperature range of -40°C (-40°F) and 50°C (122°F).
- Min 90°C Supply Conductor.
- Consult a qualified electrician to ensure correct branch circuit conductor.




CAN ICES-005 (B) / NMB-005 (B)


MOUNTING INSTALLATION INSTRUCTIONS - (SAVE INSTRUCTIONS FOR FUTURE REFERENCE).

SURFACE MOUNT WITH JBOX


- 1. Loosen the screw on the side of the housing and pull out the connecting plate.**

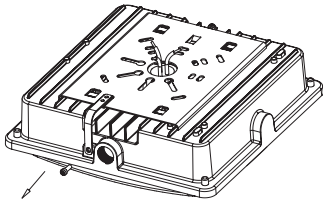

- 2. Fix the connecting plate onto the ceiling and put the wire through center hole.**




- 3. If you need to use the surface-mounted installation a circle of glue is needed around the edge of the fixed plate.**

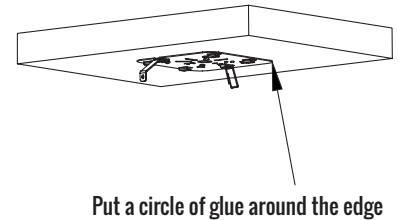


Put a circle of glue around the edge

- 4. Buckle the connecting pole into the clips and connect the wires as shown below.**

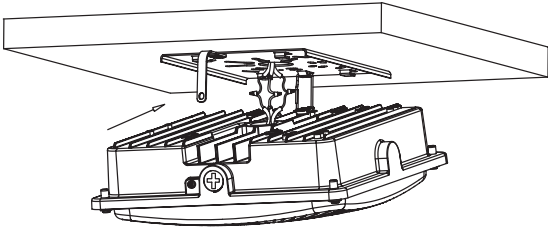


| | | |
|--------|---|---------|
| Black | ○ | Line |
| White | ○ | Neutral |
| Green | ○ | Ground |
| Purple | ○ | Dim + |
| Pink | ○ | Dim - |

- 5. Slide fixture back into the connecting plate and fix the screw.**

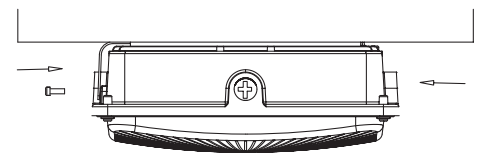


PENDANT INSTALLATION WITH 3/4 INCH CONDUIT

- 1. Loosen the screw on the side of the housing and pull out the connecting plate.**

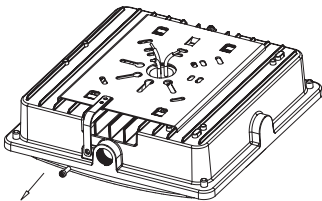



- 2. Connect the wires as shown below.**

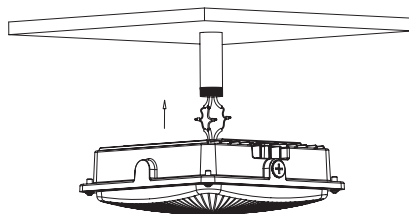

| | | |
|--------|---|---------|
| Black | ○ | Line |
| White | ○ | Neutral |
| Green | ○ | Ground |
| Purple | ○ | Dim + |
| Pink | ○ | Dim - |

- 3. Screw the lamp and conduit pole together tightly**

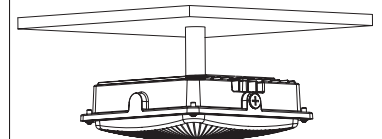


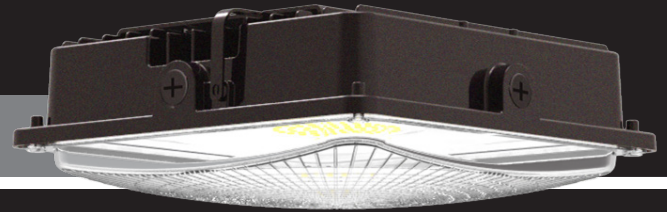

CAN ICES-005 (B) / NMB-005 (B)


CCT & POWER SELECT GUIDANCE

1. Select desired CCT, Wattage and Photocell function before connecting power.

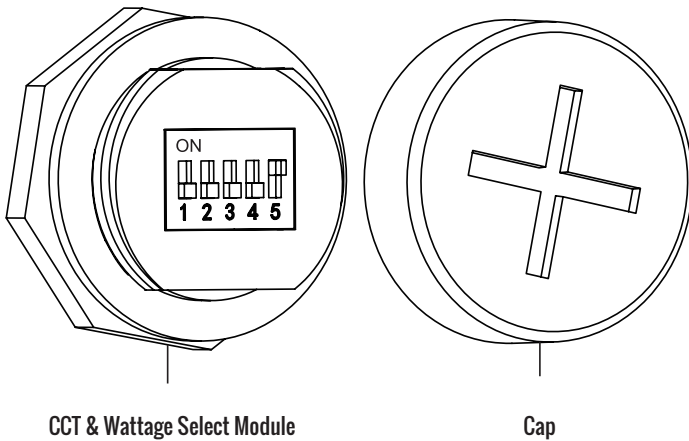


2. Cap must be screwed back securely after setting wattage, color temperature and photocell.

Wattage Select

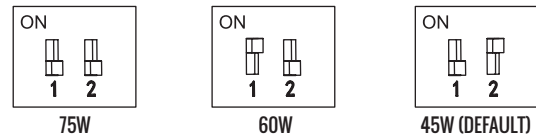

Photocell

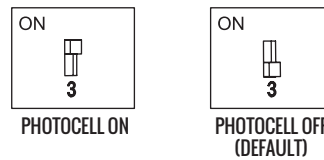

CCT Select

